




#64 – CONTINUOUSLY SHEATHED WOOD STRUCTURAL PANEL ADJACENT TO GARAGE OPENINGS

These panels apply only to garage-door side panels. If any of the following conditions cannot be met, 2'-8" panels with hold-downs or "portal frames" must be used.

- ◆ Single-story garage walls at each side of a garage door opening.
- ◆ Light-weight roofing (asphalt composition shingles).
- ◆ Entire house and garage must be sheathed with OSB or Plywood. No other materials allowed.
- ◆ All of these braced wall panels must have 1/2 inch anchor bolts, 2 x 2 x 3/16 washer and nut placed at panel quarter points, with a minimum 7-inch anchor bolt embedment into foundation.
- ◆ Truss Blocking must be installed over both panels in accordance with "Truss Blocking" handout.
- ◆ Minimum panel width shall be 24" for 8' wall height, 27" for 9' wall height, 30" for 10' wall height.
- ◆ Special corner framing per the following drawing:

Outside Corner Detail

3 stud corner, either detail can be used

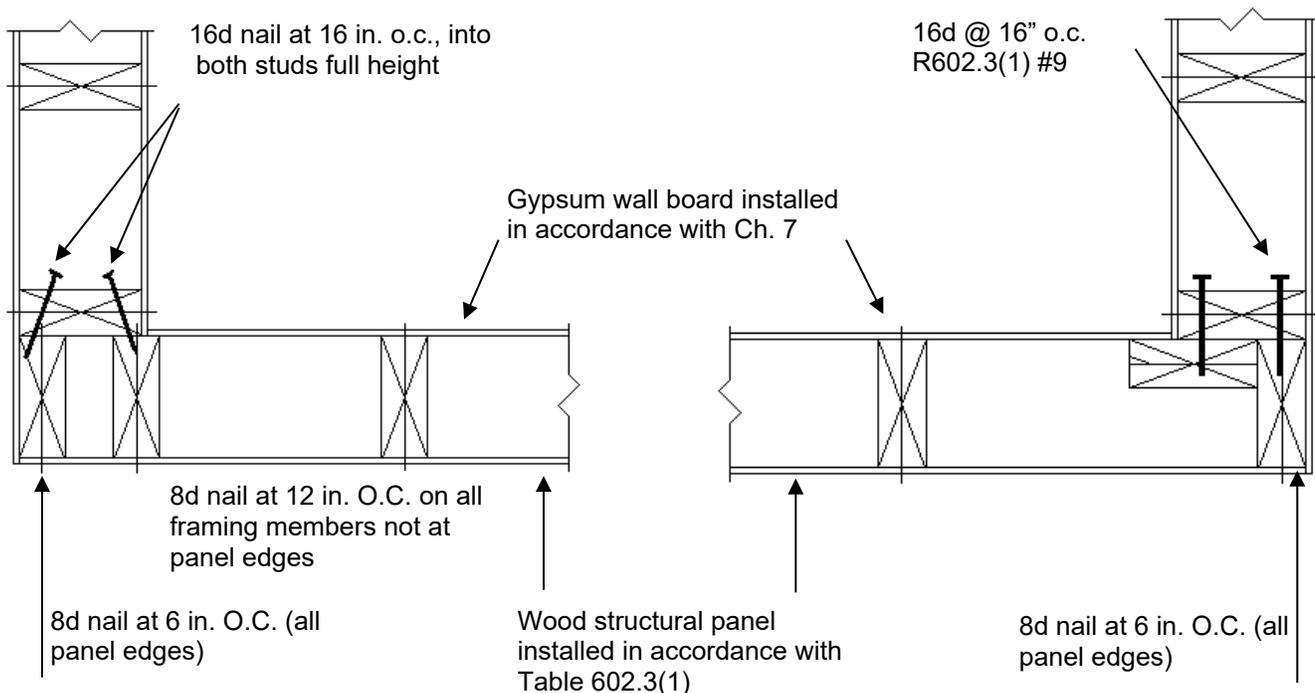

ALL NOTES APPLY TO ALL 3 PANELS

